

**Wastewater SDC Project Eligibility
Improvement Projects**

Project Number	Description	Source	% SDC Eligible	SDC Eligible Cost
WW1	NE Avery Street - Upsize gravity sewer from the Bayfront force main to the Northside pump station	Draft Master Plan	5%	\$61,500
WW2	NW Nye Street - Upsize and rehabilitate gravity sewer from the Big Creek force main to the Northside pump station	Draft Master Plan	11%	\$125,400
WW3	Nye Beach pump station - Upgrade capacity to 2.74 mgd	Draft Master Plan	10%	\$282,800
WW4	Bayfront pump station - Upgrade to 2.59 mgd	Draft Master Plan	28%	\$902,720
WW5	NE Harney Street gravity sewer	1990 Public Facilities Plan	100%	\$740,000
WW6	NE 52nd Street gravity sewer	1990 Public Facilities Plan	100%	\$259,000
WW7	NE 70th Place gravity sewer	1990 Public Facilities Plan	100%	\$371,000
WW8	Yaquina Heights Drive gravity sewer	1990 Public Facilities Plan	100%	\$1,426,600
WW9	Benson Road gravity sewer	1990 Public Facilities Plan	100%	\$1,722,600
WW10	Bayfront pump station - Upgrade force main to 14-inch diameter	Draft Master Plan	28%	\$137,200
WW11	Northside pump station - Upgrade capacity to 9.2 mgd	Draft Master Plan	100%	\$2,780,000
WW12	SE Running Springs Drive pump station - Upgrade capacity to 0.27 mgd	Draft Master Plan	100%	\$1,178,000
WW13	SE Running Springs Drive Upgrade force main to 14-inch diameter	Draft Master Plan	100%	\$330,000
WW14	Harborton to SE 50th Sewer Line Extensions	2006 SB Nbhd Plan	100%	\$754,800
WW15	SE 50th to SE 62nd Sewer Line	2006 SB Nbhd Plan	100%	\$1,979,500
WW16	SE 62nd - Construct new pumpstation	2006 SB Nbhd Plan	100%	\$1,000,000
WW17	Wilder Phase 5 Sewer Line	2006 SB Nbhd Plan	100%	\$1,206,800
WW18	Surfland/Airport - Construct new gravity system	Draft Master Plan	100%	\$4,620,000
WW19	Surfland/Airport - Construct new pump station	Draft Master Plan	100%	\$1,000,000
WW20	Surfland/Airport - Construct new force main	Draft Master Plan	100%	\$612,000

Totals

Totals \$12,064,320

Highlighted projects not included in estimate. To be funded with other resources (e.g. Urban Renewal) or are unlikely to occur in the next 20-years.


Legend

- City Limits
- Urban_Growth_Boundary
- New_or_Upgrade Pump Stations
- Future Sewer Main Projects:
 - Upgrade Existing Line
 - New Line
- Existing SS Pump Station
- Sewer Gravity Main
- Sewer Force Main

Wastewater SDC Project Eligibility Improvement Projects

Project Number	Description
WW1	NE Avery Street - Upsize gravity sewer from the Bayfront force main to the Northside pump station
WW2	NW Nye Street - Upsize and rehabilitate gravity sewer from the Big Creek force main to the Northside pump station
WW3	Nye Beach pump station - Upgrade capacity to 2.74 mgd
WW4	Bayfront pump station - Upgrade to 2.59 mgd
WW5	NE Harney Street gravity sewer
WW6	NE 52nd Street gravity sewer
WW7	NE 70th Place gravity sewer
WW8	Yaquina Heights Drive gravity sewer
WW9	Benson Road gravity sewer
WW10	Bayfront pump station - Upgrade force main to 14-inch diameter
WW11	Northside pump station - Upgrade capacity to 9.2 mgd
WW12	SE Running Springs Drive pump station - Upgrade capacity to 0.27 mgd
WW13	SE Running Springs Drive Upgrade force main to 14-inch diameter
WW14	Harborton to SE 50th Sewer Line Extensions
WW15	SE 50th to SE 62nd Sewer Line
WW16	SE 62nd - Construct new pumpstation
WW17	Wilder Phase 5 Sewer Line
WW18	Surfland/Airport - Construct new gravity system
WW19	Surfland/Airport - Construct new pump station
WW20	Surfland/Airport - Construct new force main

Projects highlighted in yellow are not recommended for funding because they are unlikely to be needed within the 20-year planning horizon.

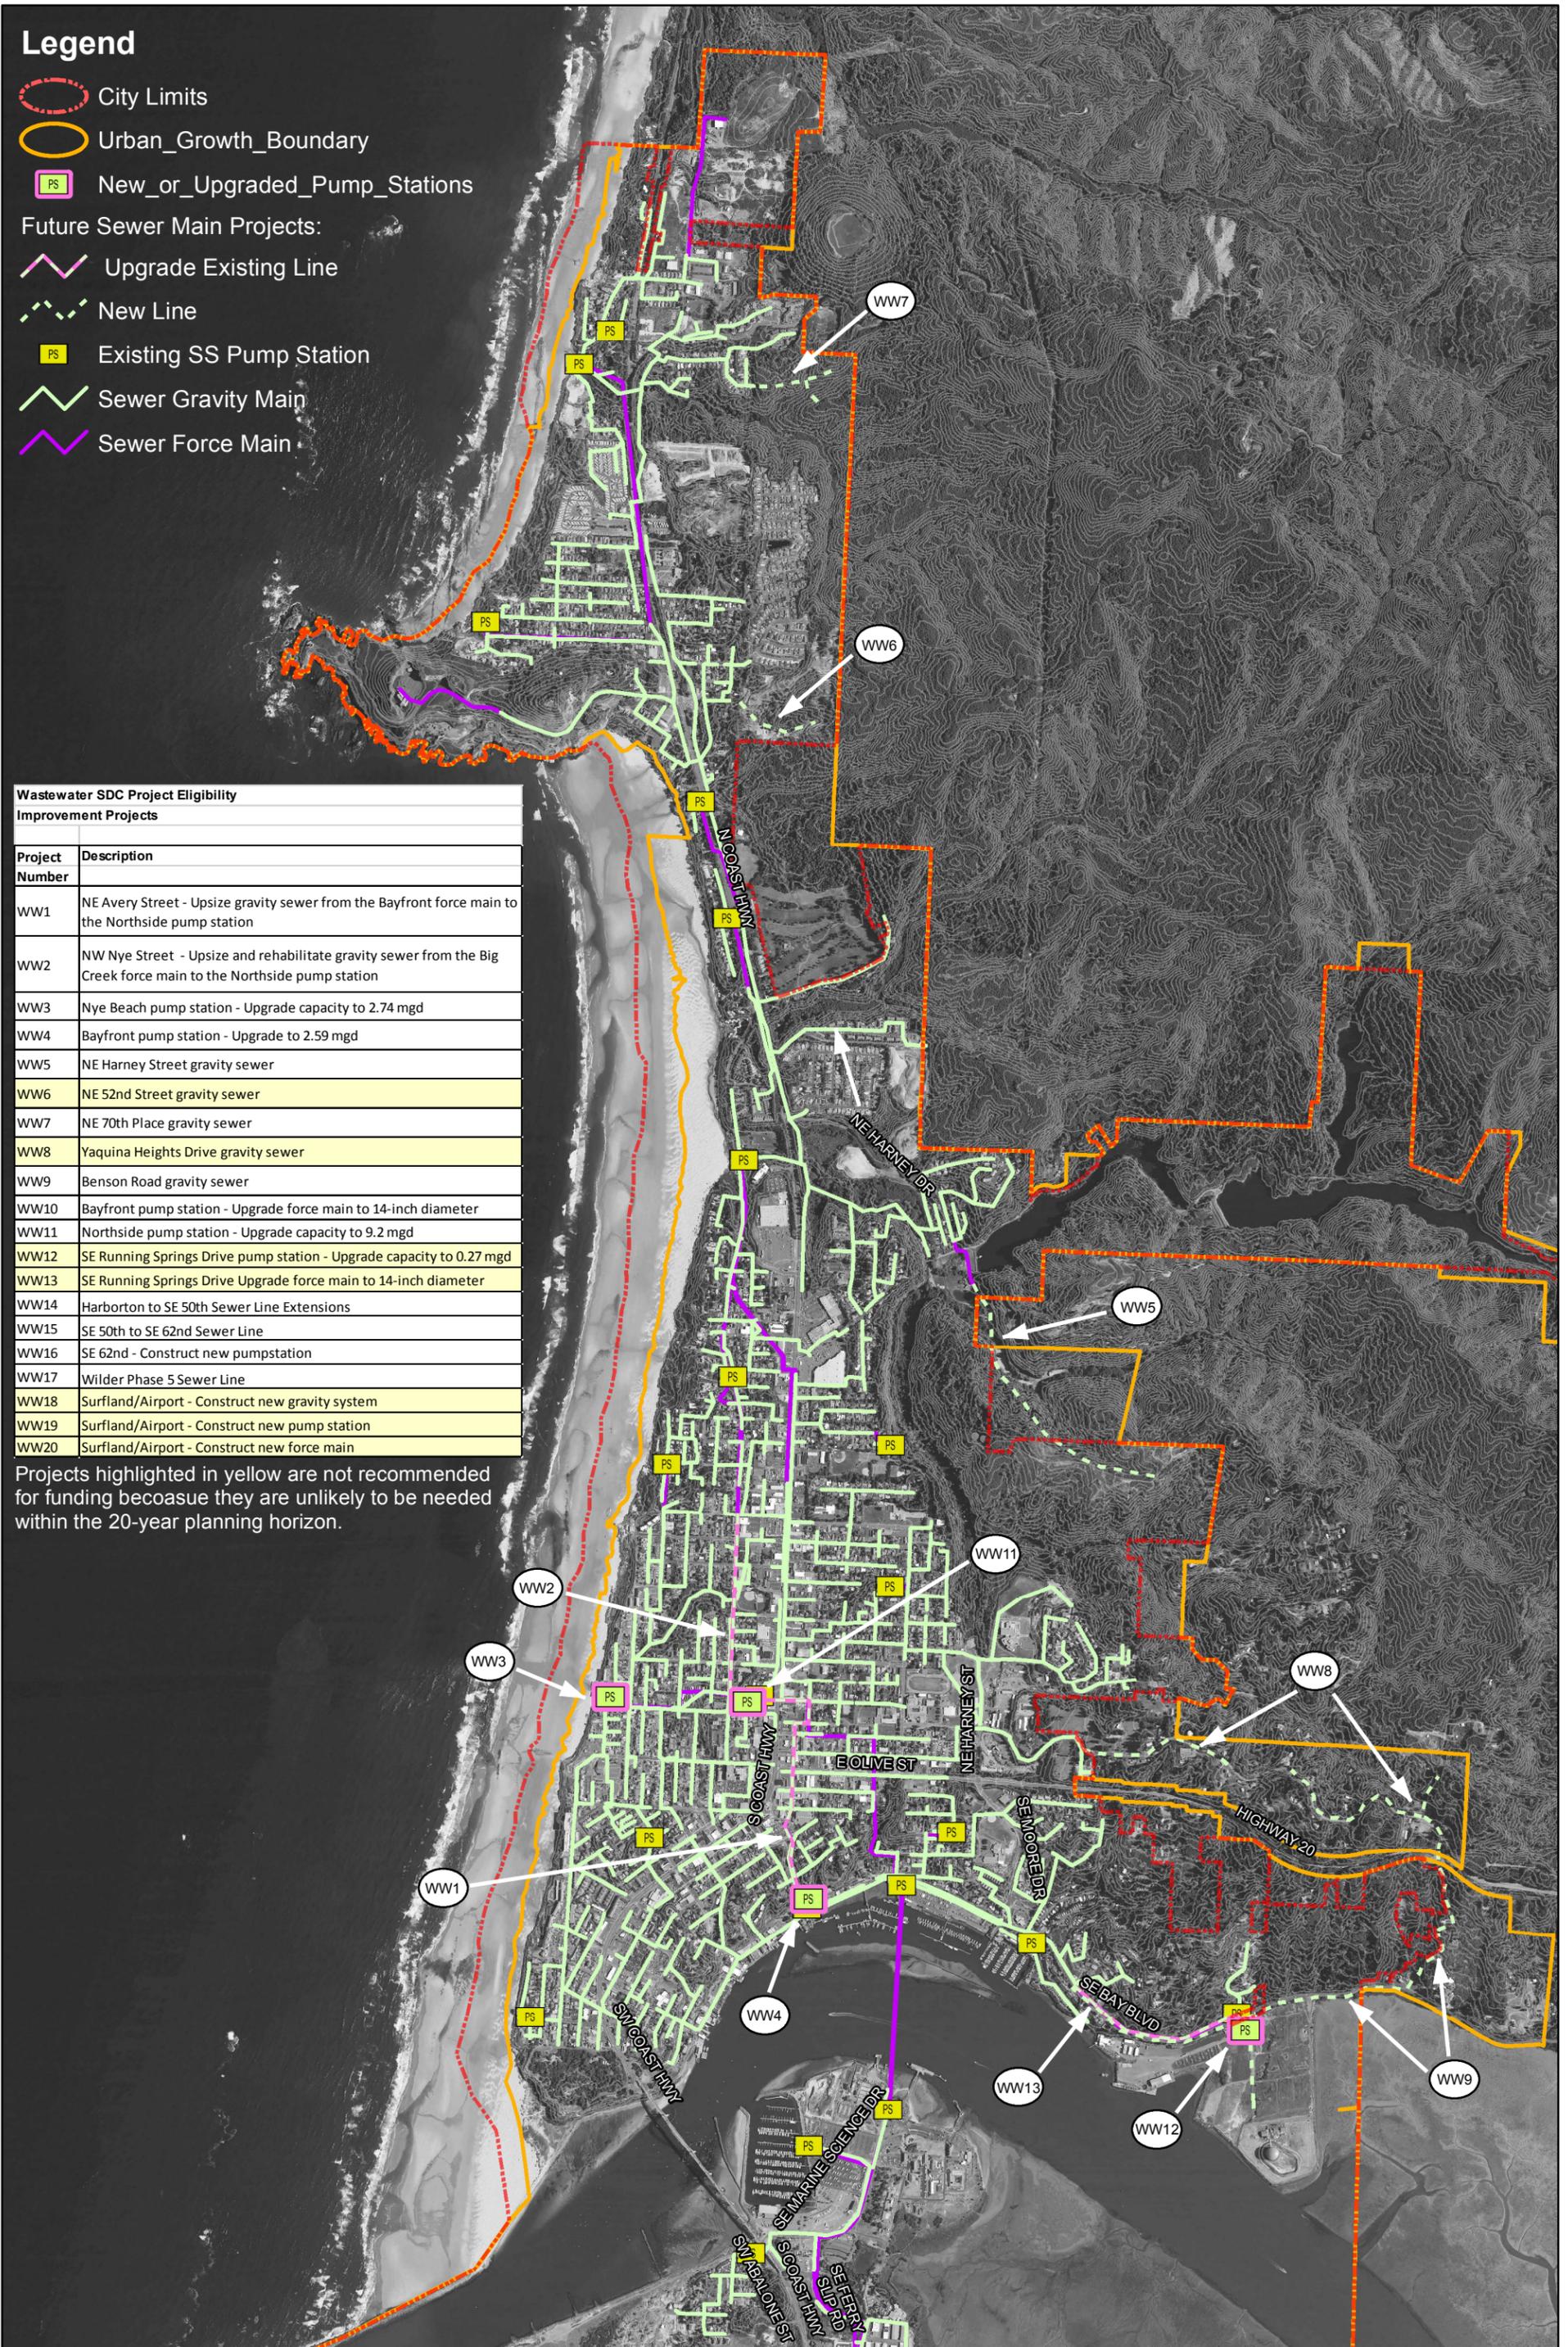

Legend

- City Limits
- Urban_Growth_Boundary
- New_or_Upgrade_Pump_Stations
- Future Sewer Main Projects:
 - Upgrade Existing Line
 - New Line
- Existing SS Pump Station
- Sewer Gravity Main
- Sewer Force Main

Wastewater SDC Project Eligibility Improvement Projects	
Project Number	Description
WW1	NE Avery Street - Upsize gravity sewer from the Bayfront force main to the Northside pump station
WW2	NW Nye Street - Upsize and rehabilitate gravity sewer from the Big Creek force main to the Northside pump station
WW3	Nye Beach pump station - Upgrade capacity to 2.74 mgd
WW4	Bayfront pump station - Upgrade to 2.59 mgd
WW5	NE Harney Street gravity sewer
WW6	NE 52nd Street gravity sewer
WW7	NE 70th Place gravity sewer
WW8	Yaquina Heights Drive gravity sewer
WW9	Benson Road gravity sewer
WW10	Bayfront pump station - Upgrade force main to 14-inch diameter
WW11	Northside pump station - Upgrade capacity to 9.2 mgd
WW12	SE Running Springs Drive pump station - Upgrade capacity to 0.27 mgd
WW13	SE Running Springs Drive Upgrade force main to 14-inch diameter
WW14	Harborton to SE 50th Sewer Line Extensions
WW15	SE 50th to SE 62nd Sewer Line
WW16	SE 62nd - Construct new pumpstation
WW17	Wilder Phase 5 Sewer Line
WW18	Surfland/Airport - Construct new gravity system
WW19	Surfland/Airport - Construct new pump station
WW20	Surfland/Airport - Construct new force main

Projects highlighted in yellow are not recommended for funding because they are unlikely to be needed within the 20-year planning horizon.

